

Outdoor sensor with weather shield  
Humidity / Temperature

For measuring the relative or absolute humidity and temperature in outdoor areas. Instead of the humidity signal, the enthalpy or the dewpoint can be selected as an output signal. NEMA 4X / IP65 rated enclosure.



5-year warranty

## Type Overview

| Type       | Output signal active humidity | Output signal passive temperature |
|------------|-------------------------------|-----------------------------------|
| 22UTH-510B | 0...5 V, 0...10 V             | Pt1000                            |
| 22UTH-510E | 0...5 V, 0...10 V             | Ni1000 (JCI)                      |
| 22UTH-510L | 0...5 V, 0...10 V             | NTC10k (10k2)                     |
| 22UTH-510M | 0...5 V, 0...10 V             | NTC10k3 (Precon)                  |
| 22UTH-510Q | 0...5 V, 0...10 V             | NTC20k                            |

## Technical Data

|                        |                                   |   |
|------------------------|-----------------------------------|---|
| <b>Electrical Data</b> | Nominal voltage                   | AC/DC 24 V  |
|                        | Nominal voltage range             | AC 21.6...26.4 V / DC 13.5...26.4 V   |
|                        | Power consumption AC              | 0.5 VA  |
|                        | Power consumption DC              | 0.3 W   |
|                        | Electrical connection             | Pluggable spring loaded terminal block max. 2.5 mm <sup>2</sup>                                       |
|                        | Cable entry                       | Cable gland with strain relief Ø6...8 mm (1/2" NPT conduit adapter included)                          |
| <b>Functional Data</b> | Sensor Technology                 | polymer capacitive sensor with stainless steel wire mesh  |
|                        | Application                       | air   |
|                        | Voltage output                    | 1x 0...5 V, 0...10 V, min. load 10 kΩ   |
|                        | Output signal active note         | output 0...5/10 V with jumper adjustable  |
|                        | Output signal passive temperature | Pt1000<br>Ni1000 (JCI)<br>NTC10k (10k2)<br>NTC10k3 (Precon)<br>NTC20k                                 |
| <b>Measuring Data</b>  | Measured values                   | relative humidity<br>Absolute humidity<br>Dew point<br>Enthalpies<br>Temperature                      |
|                        | Measuring range humidity          | 0...100% RH non-condensing  |
|                        | Measuring range temperature       | passive sensor: -30...120°F [-35...50°C]  |
|                        | Measuring range absolute humidity | adjustable at the transducer:<br>0...50 g/m <sup>3</sup> (default setting)<br>0...80 g/m <sup>3</sup> |
|                        | Measuring range enthalpy          | 0...85 kJ/kg  |
|                        | Measuring range dew point         | adjustable at the transducer:<br>40...140°F [0...50°C] (default setting)<br>0...200°F [-20...80°C]    |

|                              |  |  |
|------------------------------|--|--|
| <b>Measuring Data</b>        | Accuracy humidity                      | ±2% between 10...90% RH @ 70°F [21°C]  |
|                              | Accuracy temperature passive           | Passive sensors depending on used type<br>Pt.. : ±0.5°F @ 32°F [±0.3°C @ 0°C]<br>Ni.. : ±0.7°F @ 32°F [±0.4°C @ 0°C]<br>NTC.. : ±0.35°F @ 77°F [±0.2°C @ 25°C] |
|                              | Long-term stability                    | ±0.3% RH p.a. @ 70°F [21°C] @ 50% RH   |
|                              | Time constant $\tau$ (63%) in air duct | Relative humidity: typical 16 s<br>Temperature: typical 396 s  |
| <b>Materials</b>             | Cable gland                            | PA6, black   |
|                              | Housing                                | Cover: PC, grey<br>Bottom: PC, grey<br>seal: NBR70, black<br>UV resistant  |
| <b>Safety Data</b>           | Ambient humidity                       | short-term condensation permitted  |
|                              | Fluid humidity                         | short-term condensation permitted  |
|                              | Ambient temperature                    | -30...120°F [-35...50°C]   |
|                              | Fluid temperature                      | -30...120°F [-35...50°C]   |
|                              | Protection class IEC/EN                | III, Safety Extra-Low Voltage (SELV)   |
|                              | Power source UL                        | Class 2 Supply   |
|                              | EU Conformity                          | CE Marking   |
|                              | Certification IEC/EN                   | IEC/EN 60730-1   |
|                              | Certification UL                       | cULus acc. to UL60730-1A/-2-9/-2-13, CAN/CSA E60730-1/-2-9   |
|                              | Degree of protection IEC/EN            | IP65   |
|                              | Degree of protection NEMA/UL           | NEMA 4X  |
|                              | Enclosure                              | UL Enclosure Type 4X   |
|                              | Quality Standard                       | ISO 9001   |
|                              | Mode of operation                      | Type 1   |
|                              | Control pollution degree               | 3  |
| Rated impulse voltage supply | 0.8 kV                                 |  |
| Construction                 | Independently mounted control          |  |

### Safety Notes



This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application. Unauthorized modifications are prohibited. The product must not be used in relation with any equipment that in case of a failure may threaten humans, animals or assets.

Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Only authorized specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

### Remarks

#### General Remarks Concerning Sensors

When using lengthy connection wires (depending on the cross section used) the measuring result might be falsified due to a voltage drop at the common GND-wire (caused by the voltage current and the line resistance). In this case, 2 GND-wires must be wired to the sensor - one for supply voltage and one for the measuring current.

Sensing devices with a transducer should always be operated in the middle of the measuring range to avoid deviations at the measuring end points. The ambient temperature of transducer electronics should be kept constant. The transducers must be operated at a constant supply voltage (±0.2 V). When switching the supply voltage on/off, onsite power surges must be avoided.

**Build-up of Self-Heating by Electrical Dissipative Power**

Temperature sensors with electronic components always have a dissipative power which affects the temperature measurement of the ambient air. The dissipation in active temperature sensors shows a linear increase with rising operating voltage. The dissipative power should be taken into account when measuring temperature. In case of a fixed operating voltage ( $\pm 0.2$  V) this is normally done by adding or reducing a constant offset value. As Belimo transducers work with a variable operating voltage, only one operating voltage can be taken into consideration, for reasons of production engineering. Transducers 0...10 V / 4...20 mA have a standard setting at an operating voltage of DC 24 V. That means, that at this voltage, the expected measuring error of the output signal will be the least. For other operating voltages, the offset error will be increased by a changing power loss of the sensor electronics.

If a readjustment directly at the active sensor should be necessary during later operation, this can be done with the following adjustment methods.

- For sensors with NFC or dongle by the corresponding Belimo app
- For sensors with a trimming potentiometer on the sensor board
- For bus sensors via bus interface with a corresponding software variable

**Application notice for humidity sensors**

Refrain from touching the sensitive humidity sensor element. Touching the sensitive surface will void warranty.

For standard environmental conditions the manufacturing accuracy specified in the datasheet will be warranted for two years. When exposed to harsh environmental conditions such as high ambient temperature and/or high levels of humidity, or presence of aggressive gases (i.e. chlorine, ozone, ammonia) the sensor element may be affected and readings may be outside specified accuracy. Replacement of deteriorated humidity sensors due to harsh environmental conditions are not subject of the general warranty.

The sensor shows best performance when operated within recommended normal temperature range of 5...60°C and humidity range of 20...80% r.H. Long-term exposure to conditions outside normal range, especially at high humidity, may temporarily offset the humidity signal (e.g. +3% r.H. after 60h kept at >80% r.H.). After returning into the normal temperature and humidity range the sensor will slowly come back to calibration state by itself.


**Scope of delivery**

| Scope of delivery | Description              | Type      |
|-------------------|--------------------------|-----------|
|                   | Mounting plate L housing | A-22D-A10 |
|                   | Rain cover, for 22UTH-.. | A-22U-A01 |
|                   | Dowel                    |           |
|                   | Screws                   |           |
|                   | 1/2" NPT conduit adapter |           |


**Accessories**

| Optional accessories | Description                                    | Type      |
|----------------------|--|-----------|
|                      | Replacement filter, wire mesh, Stainless steel | A-22D-A06 |


Wiring Diagram

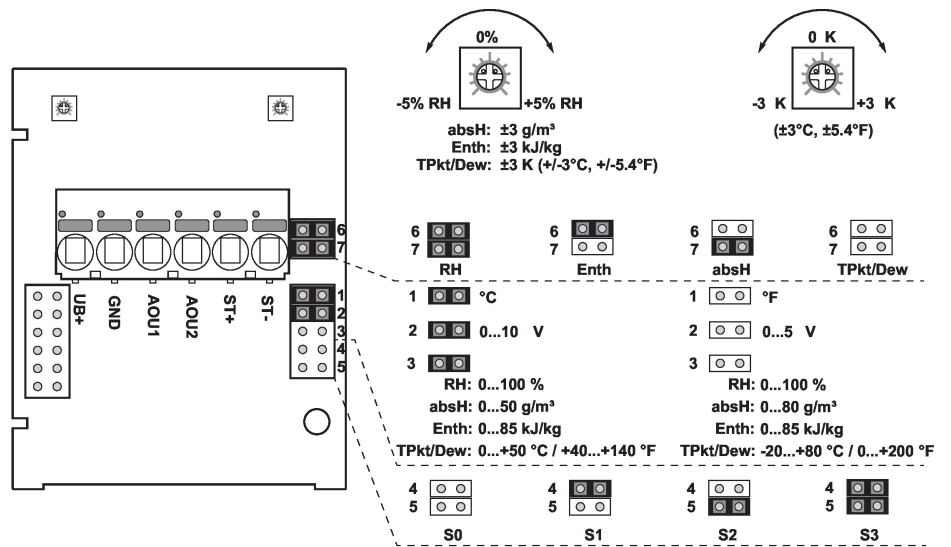

0...5/10 V + ST



rH Relative humidity  
 absH Absolute humidity  
 Enth Enthalpy  
 TPkt/Dew Dew point  
 (Measurement value available on Output AOU1)

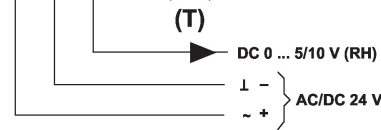


Connectors ST+ / ST- are only used for sensor types which additionally have a passive resistance sensor element for temperature measurement.

The adjustment of the measuring ranges is made by changing the bonding jumpers.

The output value in the new measuring range is available after 2 seconds.

## Dimensions

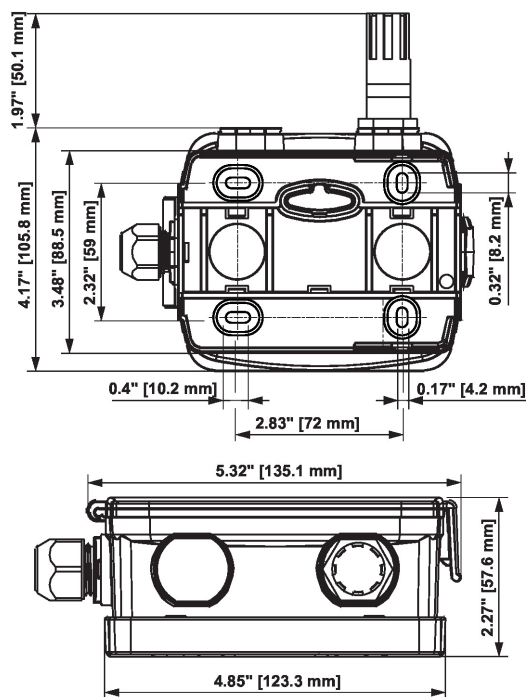

| Type       | Weight            |
|------------|-------------------|
| 22UTH-510B | 0.62 lb [0.28 kg] |
| 22UTH-510E | 0.62 lb [0.28 kg] |
| 22UTH-510L | 0.62 lb [0.28 kg] |
| 22UTH-510M | 0.62 lb [0.28 kg] |
| 22UTH-510Q | 0.62 lb [0.28 kg] |